
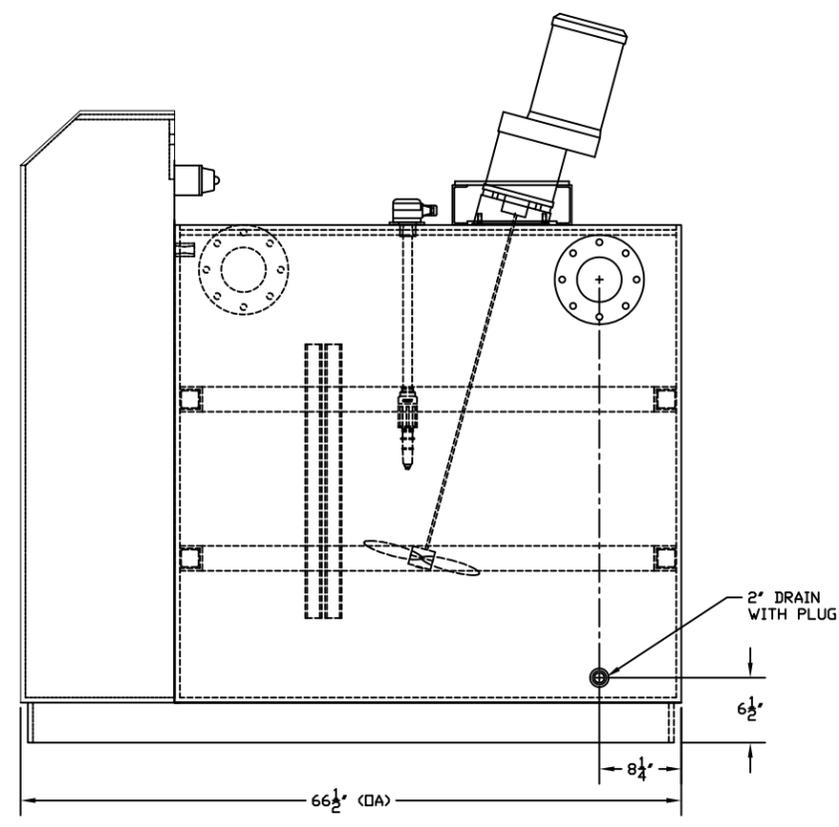


| ITEM | QTY. | DESCRIPTION |
|------|------|--|
| 1 | 2 | REAGENT METERING PUMP #LPH7EA-WTC3 |
| 2 | 2 | REAGENT LOW LEVEL SENSOR LSF-130-Q1-S |
| 3 | 1 | CONTROL PANEL |
| 4 | 1 | PHX pH QUICKTWIST TRANSMITTER ASSEMBLY (#3-2724-00/3-2751-3) |
| 5 | 1 | PHX TANK ASSEMBLY |

NOTES:

1)

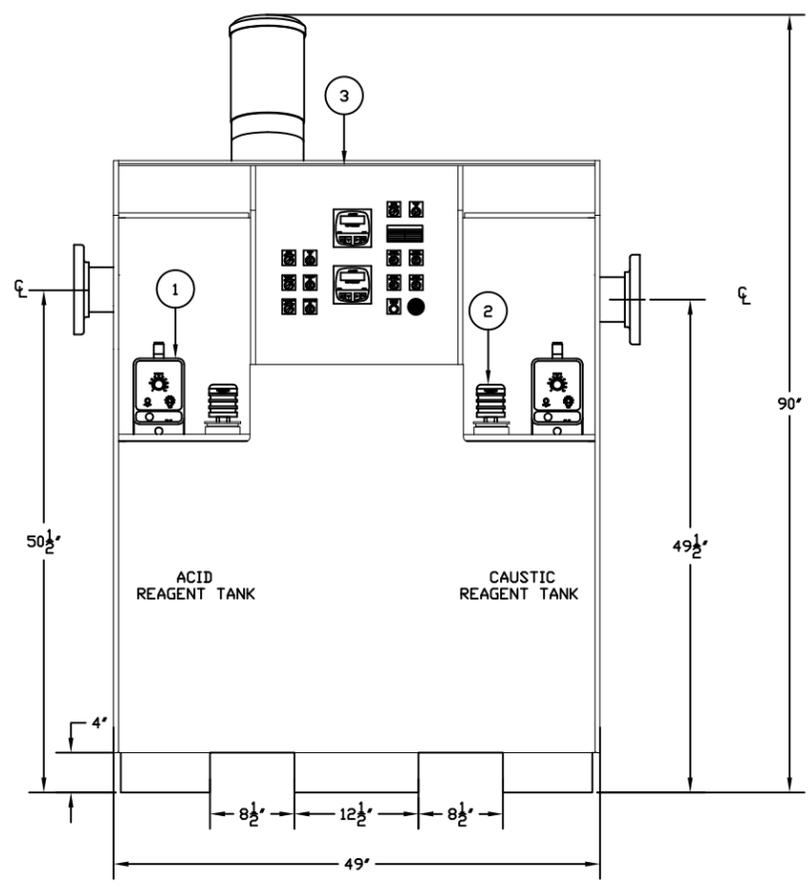

| NO. | DATE | DESCRIPTION | BY |
|-----|------|----------------------------|----|
| A | | ISSUED FOR CUSTOMER REVIEW | |

| ESTIMATED WEIGHT | | SERVICE REQ. | |
|------------------|---------|--------------|---|
| SHIPPING | 550 # | PRIM. ELEC. | - |
| OPERATING | 4,225 # | SEC. ELEC. | - |
| | | PNEUMATIC | - |
| | | WATER | - |

BURT PROCESS EQUIPMENT
 FLUID HANDLING EQUIPMENT SINCE 1970
 100 Overlook Drive, Hamden, CT 06514 (203) 287-1985
 www.BurtProcess.com

| | |
|------------|---------------------|
| CUSTOMER: | ENG. BY: |
| | DWN. BY: |
| SCALE: NTS | BPE JOB NO.: IXXXXX |
| | APP. BY: |

TITLE:
**PHX-400
 pH ADJUSTMENT SYSTEM**

| | |
|-----------------|---------|
| DWG NO.: 1 OF 1 | REV.: A |
|-----------------|---------|

THIS DRAWING CONTAINS PROPRIETARY INFORMATION WHICH IS INTENDED FOR USE BY ONLY THOSE PARTIES LISTED AND MAY NOT BE MODIFIED, REPRODUCED, OR RETRANSMITTED WITHOUT THE CONSENT OF BURT PROCESS EQUIPMENT.