



ITEM	QTY	DESCRIPTION	BPe (#s)
1	1	NALGENE MOLDED POLYPROPYLENE TANK (#14200-0020)	ZZ00000E
2	1	1/2" THK. "BLUE" POLYPROPYLENE COVER (SIZE TO FIT)	CU34000E
3	1	WEBSTER PUMP #SSP8-1366V (3/4HP,115/230VAC,1Ø)	WE77040H
4	1	1/2" THK. "BLUE" POLYPROPYLENE PUMP BASEPLATE	CU34000E
5	1	LSF-105 LEVEL CONTROL (2-POINT)	BG56500E
6	1	1/2" THK. BLUE POLYPROPYLENE LEVEL CONTROL BASE	CU34800E
7	1	1 1/4" CPVC (SCH.80) PIPE **(SUCTION)**	EE13000H
8	1	1" CPVC 90° ELBOW (SDC.)	EH36500H
9	1	1" CPVC UNION (SDC.)	EH40000H
10	A/R	1" CPVC (SCH.80) PIPE	EE13000H
11	1	1" POLYPROPYLENE F.C. **(PUMP DISCHARGE)**	NL41000E
12	1	ASAHI 1" CPVC CHECK VALVE (THD.)	AK18002H
13	1	1 1/2" POLYPROPYLENE H.C. **(INLET)**	NL43000E
14	1	1"X4" LONG CPVC NIPPLE	ED14400H



\*\*(DETAIL (A))\*\*  
1/2" THK. "BLUE" POLYPROPYLENE  
BOLT DOWN COVER (SIZE TO FIT)\*\*

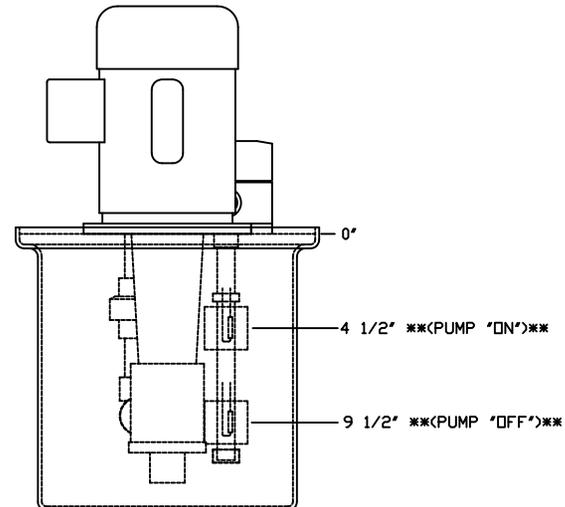

**NOTES:**

- TEST LIQUID LEVEL CONTROL OPERATION AND PUMP ROTATION.
- PUMP TO TURN ON AT 4 1/2", AND PUMP TO TURN OFF AT 9 1/2".
- HARDWARE TO BE 1/4"-20 S.S. HEX HEAD BOLTS W/(2) FLAT WASHERS, (1) LOCK WASHER & (1) REG. NUT PER ASS'Y. NUTS TO BE TIGHTENED TO FULL COMPRESSION OF SPLIT LOCK.
- AFFIX BPe LABEL AND MODEL # TAG TO LEVEL CONTROL. AFFIX BPe LABEL AND MODEL # (OF SUMP) TO TANK FRONT WALL.
- DO NOT REMOVE TOP PLUG ON PUMP BODY. REMOVAL MAY CAUSE MOTOR DAMAGE DUE TO FUME EXPOSURE.
- SEE DRAWING #XXXXXX FOR LEVEL CONTROL DRAWING.

NO.	DATE	DESCRIPTION	BY

ESTIMATED WEIGHT	SERVICE REQ.	
	SHIPPING	PRIM. ELEC.
OPERATING	SEC. ELEC.	PNEUMATIC
		WATER



CUSTOMER:	ENG. BY:
	DWN. BY:
	AFS
SCALE: NTS	BPE JOB NO.:
	APP. BY:
TITLE: <b>PPS-155 SIMPLEX TRANSFER STATION</b>	
DWG NO.:	REV.:
	0F

THIS DRAWING CONTAINS PROPRIETARY INFORMATION WHICH IS INTENDED FOR USE BY ONLY THOSE PARTIES LISTED AND MAY NOT BE MODIFIED, REPRODUCED, OR RETRANSMITTED WITHOUT THE CONSENT OF BURT PROCESS EQUIPMENT.