
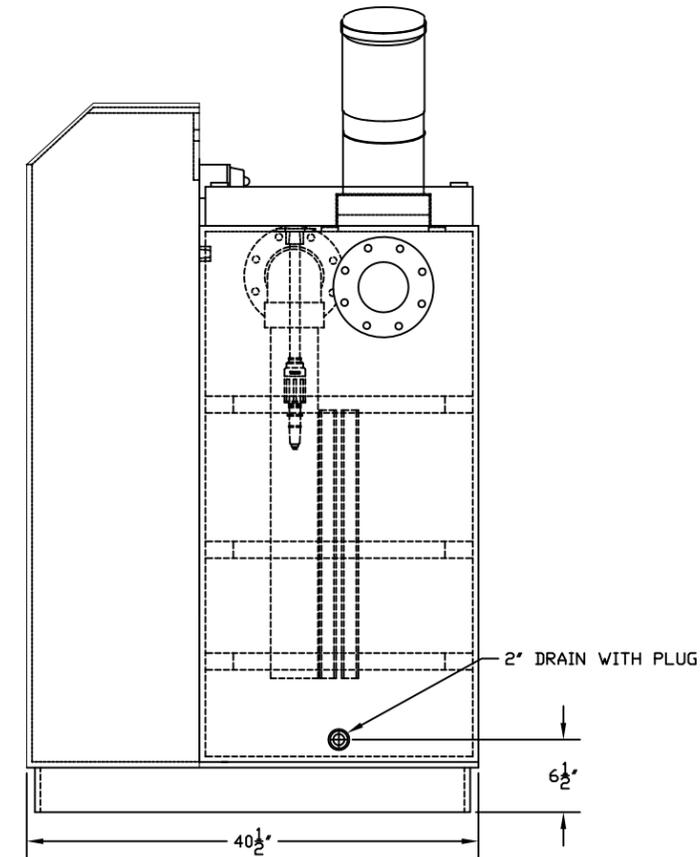


ITEM	QTY.	DESCRIPTION
1	2	REAGENT METERING PUMP #LPH6EA-VTC3
2	2	REAGENT LOW LEVEL SENSOR LSF-130-Q1-S
3	1	CONTROL PANEL
4	1	PHX pH QUICKTWIST TRANSMITTER ASSEMBLY (#3-2724-00/3-2751-3)
5	1	PHX TANK ASSEMBLY

**NOTES:**

1)

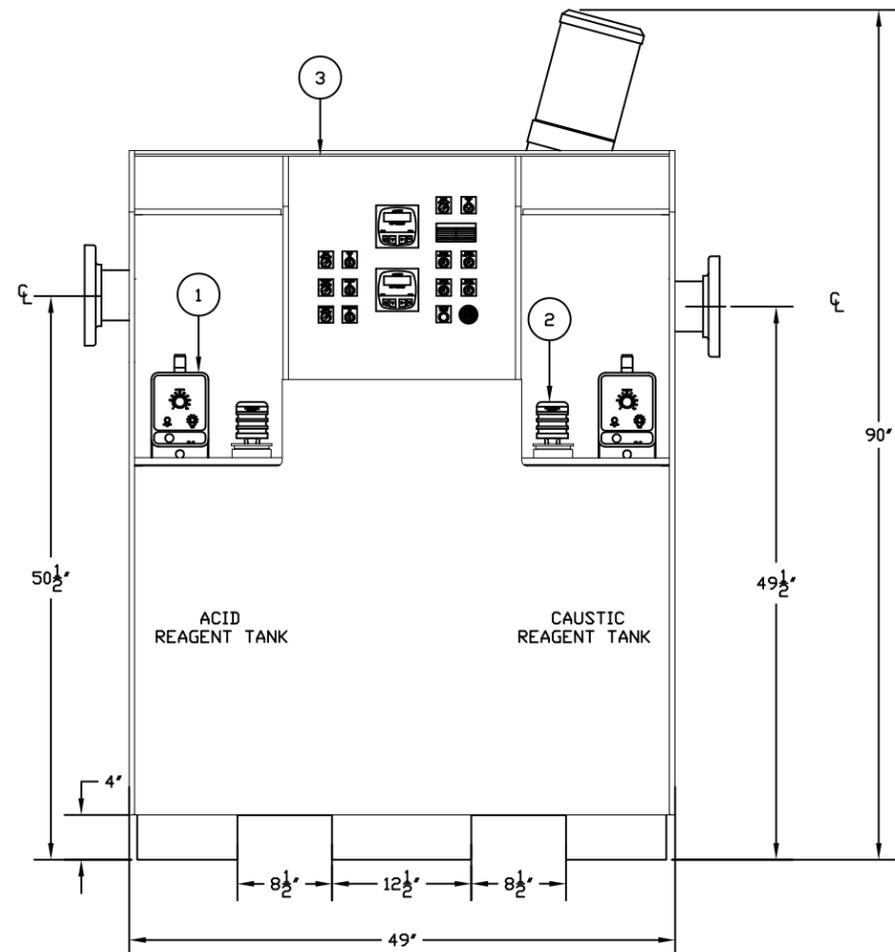

REVISIONS			
NO.	DATE	DESCRIPTION	BY
A		ISSUED FOR CUSTOMER REVIEW	

ESTIMATED WEIGHT		SERVICE REQ.	
SHIPPING	425 #	PRIM. ELEC.	-
OPERATING	2,275 #	SEC. ELEC.	-
		PNEUMATIC	-
		WATER	-

**BURT PROCESS EQUIPMENT**  
 FLUID HANDLING EQUIPMENT SINCE 1970  
 100 Overlook Drive, Hamden, CT 06514 (203) 287-1985  
 www.BurtProcess.com

CUSTOMER:		ENG. BY:
		DWN. BY:
SCALE: 1/8"=1"	BPE JOB NO.: IXXXXX	APP. BY:

TITLE:  
**PHX-200  
 pH ADJUSTMENT SYSTEM**

DWG NO.: 1 OF 1	REV.: A
--------------------	------------

THIS DRAWING CONTAINS PROPRIETARY INFORMATION WHICH IS INTENDED FOR USE BY ONLY THOSE PARTIES LISTED AND MAY NOT BE MODIFIED, REPRODUCED, OR RETRANSMITTED WITHOUT THE CONSENT OF BURT PROCESS EQUIPMENT.